


EXISTING Direct Cooling System

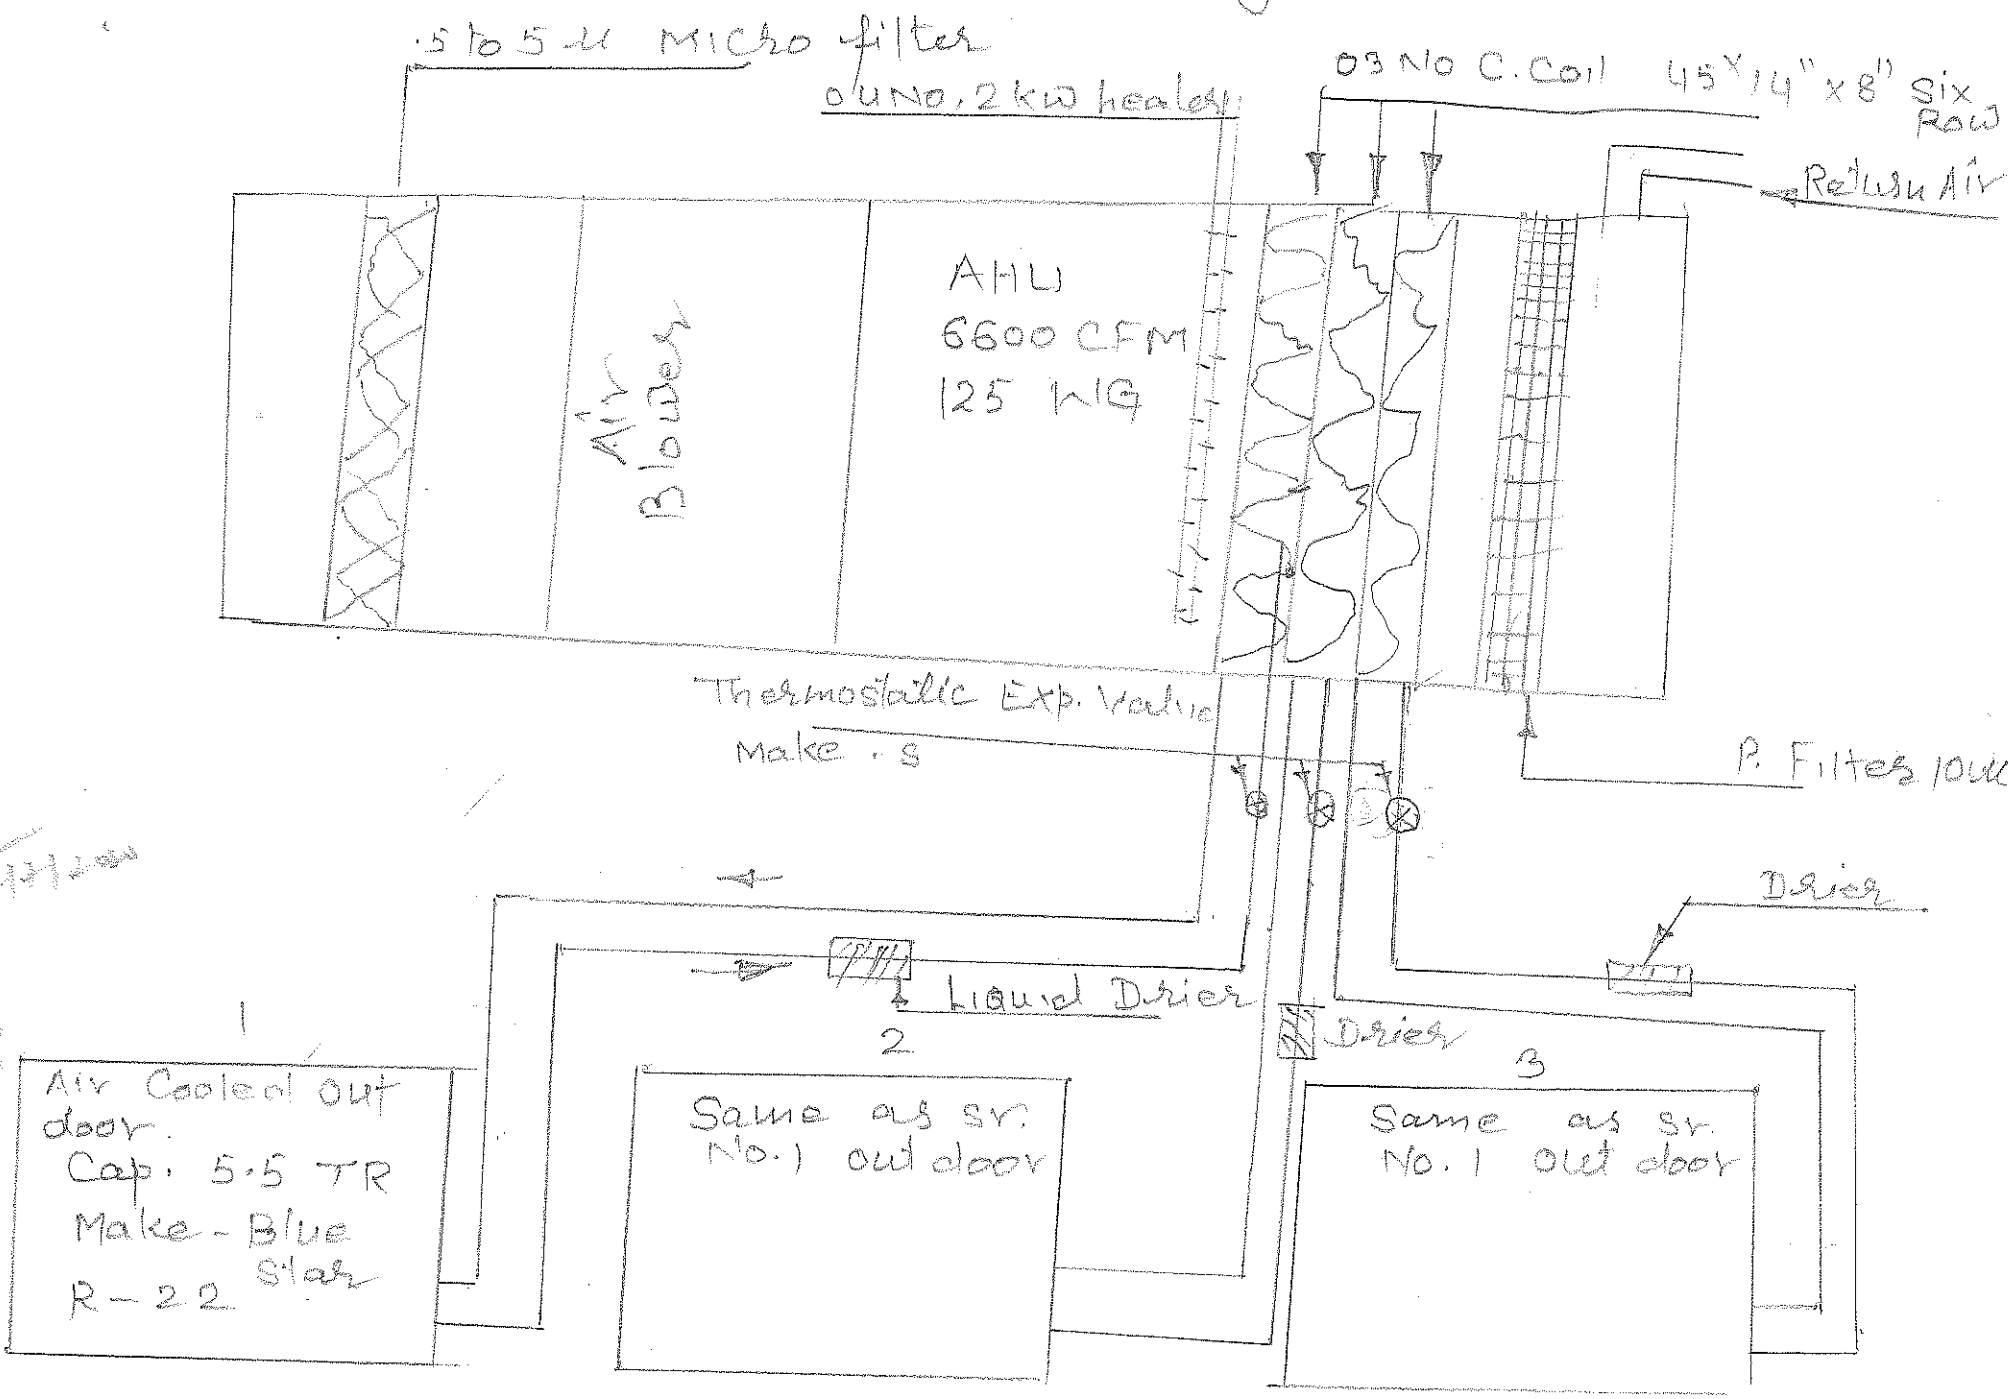

2/2/2000